




Craven County Water Gate Valve Notice

All meters will be locked when placed or installed. You must install a GATE VALVE within 18" of the meter. This valve must be placed in a box provided by the customer.

Once the gate valve is installed properly, you must call **252-636-6615** to have the valve inspected.

If the meter passes inspection, the meter will be unlocked. If the meter does not pass inspection, the meter will remain locked, and you will be charged an additional inspection fee for another scheduled inspection.

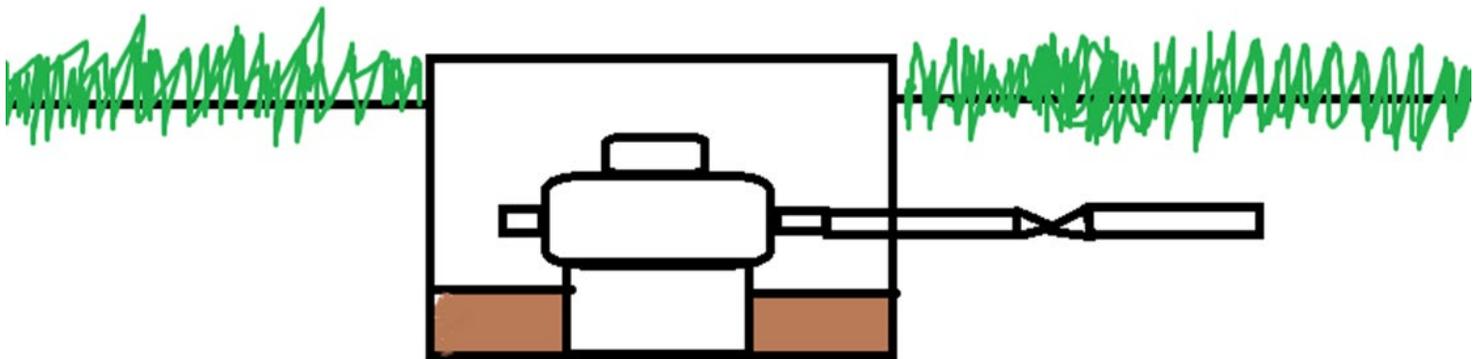

Printed Name

Signature

Telephone Number

Date

*If you are purchasing a 2-inch tap, you will be required to purchase and install your own testable backflow device. Please install it per the instructions given, or the inspection will automatically fail.

You will be provided with a flag to place in the NC DOT right-of-way. This flag must be placed within 24 hours to begin locating. We will place the tap *as close to that flag as possible***. However, some things may make it impossible to place that tap where you prefer. (Ex: proximity to DOT items such as culverts, electricity appurtenances or water line availability.)

If you do not hook up your water service, you will still be charged the monthly availability fee.

Your availability fee is \$_____.

You will be charged this fee whether you register consumption or not.